


# Energy Management Smart Modular Power Analyzer Type WM30 96

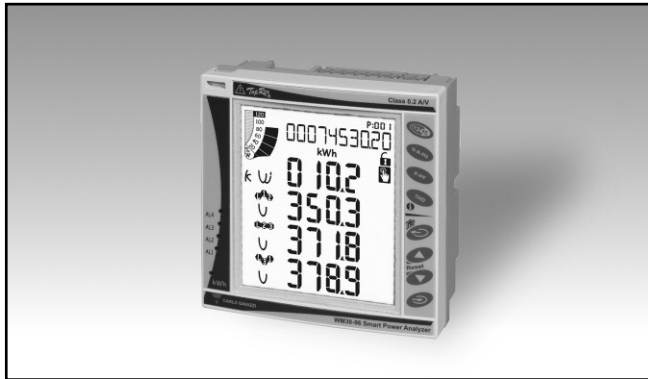

- Front protection degree: IP65, NEMA4X, NEMA12
- One RS232 or RS485 port (on request)
- Communication protocol: MODBUS-RTU, iFIX SCADA compatibility
- MODBUS TCP/IP Ethernet port (on request)
- BACNet-IP over Ethernet port (on request)
- Up to 2 digital outputs (pulse, alarm, remote control) (on request)
- Up to 4 freely configurable virtual alarms
- Up to 2 analogue outputs (+20mA, +10VDC) (on request)

- Class 0.5 (kWh) according to EN62053-22
- Class C (kWh) according to EN50470-3
- Class 2 (kvarh) according to EN62053-23
- Accuracy  $\pm 0.2\%$  RDG (current/voltage)
- Instantaneous variables readout: 4x4 DGT
- Energies readout: 9+1 DGT
- System variables: VLL, VLN, A, VA, W, var, PF, Hz, Phase-sequence-asymmetry-loss.
- Single phase variables: VLL, VLN, AL, An (calculated), VA, W, var, PF
- Both system and single phase variables with average and max calculation
- Harmonic analysis (FFT) up to the 32nd harmonic (current and voltage)
- Energy measurements (imported/exported): total and partial kWh and kvarh
- Energy measurements according to ANSI C12.20 CA 0.5, ANSI C12.1 (revenue grade)
- Run hours counter (8+2 DGT)
- Real time clock function
- Application adaptable display and programming procedure (Easyprog function)
- Universal power supply: 18 to 60VAC/DC, 90 to 260AC/VDC
- Front dimensions: 96x96 mm


## Product Description

Three-phase smart power analyzer with built-in advanced configuration system and LCD data displaying. Particularly recommended for the measurement of the main electrical variables. WM30 is based on a modular housing for panel mounting with IP65 (front) protection degree. Moreover, the analyzer can

be provided with digital outputs that can be either for pulse proportional to the active and reactive energy being measured or/and for alarm outputs. The instrument can be equipped with the following modules: RS485/RS232, Ethernet, BACNet-IP communication ports, pulse and alarm outputs.

## How to order

**WM30-96 AV5 3 H R2 A2 S1 XX**

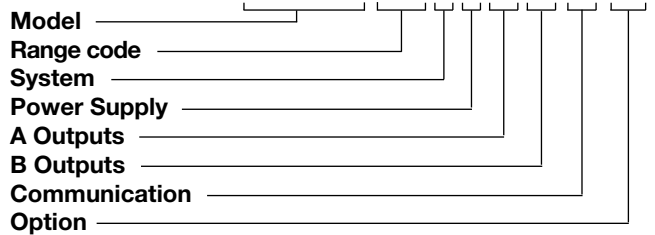

## Type Selection

Range codes	System	Power supply	A Outputs
<b>AV4:</b> 400/690V <sub>LL</sub> AC 1(2)A (**) V <sub>LN</sub> : 160V to 480V <sub>LN</sub> V <sub>LL</sub> : 277V to 830V <sub>LL</sub>	<b>3:</b> balanced and unbalanced load: 3-phase, 4-wire; 3-phase, 3-wire; 2-phase, 3-wire; 1-phase, 2-wire (*)	<b>H:</b> 90 to 260V AC/DC (48 to 62Hz) (*)	<b>XX:</b> none (*)
<b>AV5:</b> 400/690V <sub>LL</sub> AC 5(6)A (*) V <sub>LN</sub> : 160V to 480V <sub>LN</sub> V <sub>LL</sub> : 277V to 830V <sub>LL</sub>		<b>L:</b> 18 to 60VAC/DC (48 to 62Hz) (**)	<b>O2:</b> Dual channel static output (*)
<b>AV6:</b> 100/208V <sub>LL</sub> AC 5(6)A (**) V <sub>LN</sub> : 40V to 144V <sub>LN</sub> V <sub>LL</sub> : 70V to 250V <sub>LL</sub>	<b>Options</b>  <b>XX:</b> none	<b>Communication</b>  <b>XX:</b> none (*) <b>S1:</b> RS485/RS232 port (*) <b>E2:</b> Ethernet / Internet port (**) <b>B1:</b> BACNet (IP) over Ethernet (**)	<b>R2:</b> Dual channel relay output (*)
<b>AV7:</b> 100/208V <sub>LL</sub> AC 1(2)A (**) V <sub>LN</sub> : 40V to 144V <sub>LN</sub> V <sub>LL</sub> : 70V to 250V <sub>LL</sub>			<b>B Outputs</b>  <b>XX:</b> none (*) <b>A2:</b> Dual channel 20mA DC output (*) <b>V2:</b> Dual channel 10V DC output (*)

(\*) as standard.  
(\*\*) on request.

## Position of modules and combination

Ref	Description	Main features	Part number	Pos. A	Pos. B	Pos. C
1	WM30 base provided with display, power supply, measuring inputs	<ul style="list-style-type: none"> <li>Inputs/system: AV5.3</li> <li>Power supply: H</li> </ul>	WM30 AV5 3 H			
2		<ul style="list-style-type: none"> <li>Inputs/system: AV6.3</li> <li>Power supply: H</li> </ul>	WM30 AV6 3 H			
3		<ul style="list-style-type: none"> <li>Inputs/system: AV5.3</li> <li>Power supply: L</li> </ul>	WM30 AV5 3 L			
4		<ul style="list-style-type: none"> <li>Inputs/system: AV6.3</li> <li>Power supply: L</li> </ul>	WM30 AV6 3 L			
5	Dual relay output (SPDT)	<ul style="list-style-type: none"> <li>2-channel</li> <li>Alarm or/and pulse output</li> </ul>	M O R2 (1)	X		
6	Dual static output (AC/DC Opto-Mos)	<ul style="list-style-type: none"> <li>2-channel</li> <li>Alarm or/and pulse output</li> </ul>	M O O2 (1)	X		
7	Dual analogue output (+20mADC)	<ul style="list-style-type: none"> <li>2-channel</li> </ul>	M O A2 (2)		X	
8	Dual analogue output (+10VDC)	<ul style="list-style-type: none"> <li>2-channel</li> </ul>	M O V2 (2)		X	
9	RS485 / RS232 port module	<ul style="list-style-type: none"> <li>Max. 115.2 Kbps</li> </ul>	M C 485 232 (3)			X
10	Ethernet port module	<ul style="list-style-type: none"> <li>RJ45 10/100 BaseT</li> </ul>	M C ETH (3)			X
11	BACNet-IP port module	<ul style="list-style-type: none"> <li>Based on Ethernet bus</li> </ul>	M C BACnet-IP (3)			X

### NOTE:

(1) Only one A type module per meter in a maximum combination of 3 total mixed modules on the same meter.


(2) Only one B type module per meter in a maximum combination of 3 total mixed modules on the same meter.

(3) Only one C type module per meter in a maximum combination of 3 total mixed modules on the same meter.

The B-C position is not mandatory, if to fulfil the application, module "A" is not necessary, then maybe just "B" can be mounted.

Another example: if modules "A" and "B" (anyone) are not needed, then just module "C" maybe be mounted. If "A" module is needed, it is mandatory to put it in "A" position.

**When no modules are mounted, then WM30-96 becomes a simple indicator.**

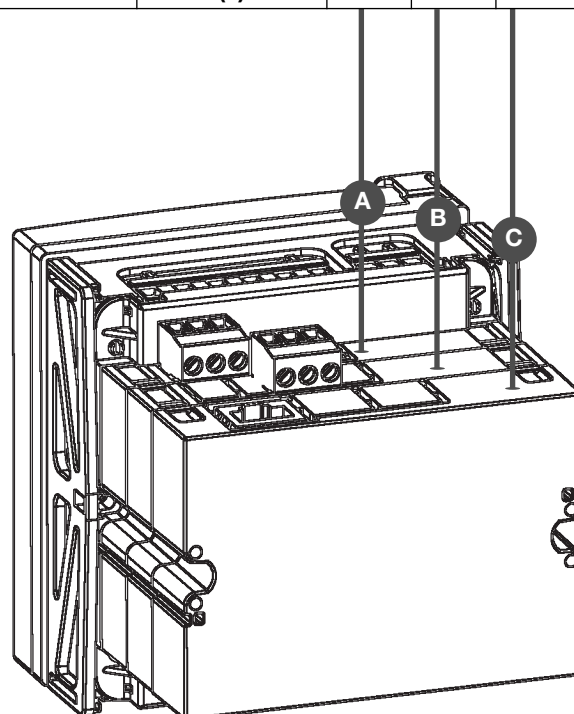

## Input specifications

<b>Rated inputs</b>	System type: 1, 2 or 3-phase Galvanic insulation by means of built-in CT's	<b>Energy additional errors</b>	According to EN62053-22, ANSI C12.20, Class B or C according to EN50470-3, EN62053-23, ANSI C12.1
Current type	AV5 and AV6: 5(6)A AV4 and AV7: 1(2)A	Influence quantities	
Current range (by CT)		<b>Total Harmonic Distortion (THD)</b>	±1% FS (FS: 100%) AV4: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS; Umax: 585Vp AV5: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS; Umax: 585Vp AV6: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS; Umax: 585Vp AV7: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS; Umax: 585Vp
Voltage (by direct connection or VT/PT)	AV4, AV5: 400/690VLL; AV6, AV7: 100/208VLL	<b>Temperature drift</b>	≤200ppm/°C
<b>Accuracy</b> (Display + RS485) (@25°C ±5°C, R.H. ≤60%, 48 to 62 Hz)	In: see below, Un: see below	<b>Sampling rate</b>	3200 samples/s @ 50Hz, 3840 samples/s @ 60Hz
AV4 model	In: 1A, Imax: 2A; Un: 160 to 480VLN (277 to 830VLL)	<b>Measurements</b>	See "List of the variables that can be connected to:"
AV5 model	In: 5A, Imax: 6A; Un: 160 to 480VLN (277 to 830VLL)	Method	TRMS measurements of distorted wave forms.
AV6 model	In: 5A, Imax: 6A; Un: 40 to 144VLN (70 to 250VLL)	Coupling type	By means of CT's
AV7 model	In: 1A, Imax: 2A; Un: 40 to 144VLN (70 to 250VLL)	<b>Crest factor</b>	AV5, AV6: ≤3 (15A max. peak) AV4, AV7: ≤3 (3A max. peak)
Current AV4, AV5, AV6, AV7 models	From 0.01In to 0.05In: ±(0.5% RDG +2DGT) From 0.05In to Imax: ±(0.2% RDG +2DGT)	<b>Current Overloads</b>	Continuous (AV5 and AV6) 6A, @ 50Hz Continuous (AV4 and AV7) 2A, @ 50Hz For 500ms (AV5 and AV6) 120A, @ 50Hz For 500ms (AV4 and AV7) 40A, @ 50Hz
Phase-neutral voltage	In the range Un: ±(0,2% RDG +1DGT)	<b>Voltage Overloads</b>	Continuous 1.2 Un For 500ms 2 Un
Phase-phase voltage	In the range Un: ±(0.5% RDG +1DGT)	<b>Input impedance</b>	400VL-L (AV4 and AV5) > 1.6MΩ 208VL-L (AV6 and AV7) > 1.6MΩ 5(10)A (AV5 and AV6) < 0.2VA 1(2)A (AV4 and AV7) < 0.2VA
Frequency	±0.1Hz (45 to 65Hz)	<b>Frequency</b>	40 to 440 Hz
Active and Apparent power	0.01In to 0.05In, PF 1: ±(1%RDG+1DGT) From 0.05In to Imax PF 0.5L, PF1, PF0.8C: ±(0.5%RDG+1DGT)		
Power Factor	±[0.001+0.5% (1.000 - "PF RDG")]		
Reactive power	0.1In to Imax, senφ 0.5L/C: ±(1%RDG+1DGT) 0.05In to 0.1In, senφ 0.5L/C: ±(1.5%RDG+1DGT) 0.05In to Imax, senφ 1: ±(1%RDG+1DGT) 0.02In to 0.05In, senφ 1: ±(1.5%RDG+1DGT)		
Active energy	Class 0.5 according to EN62053-22, ANSI C12.20 Class C according to EN50470-3.		
Reactive energy	Class 1 according to EN62053-23, ANSI C12.1.		
Start up current AV5, AV6	5mA		
Start up current AV4, AV7	1mA		

## Output specifications

<b>Relay outputs (M O R2)</b>		Min. response time	≤200ms, filters excluded. Set-point on-time delay: “0 s”.
Physical outputs	2 (max. one module per instrument)	Pulse	
Purpose	For either alarm output or pulse output	Signal retransmission	Total: +kWh, -kWh, +kvarh, -kvarh. Partial: +kWh, -kWh, +kvarh, -kvarh. The above listed variables can be connected to any output.
Type	Relay, SPDT type AC 1-5A @ 250VAC; AC 15-1.5A @ 250VAC DC 12-5A @ 24VDC; DC 13-1.5A @ 24VDC	Pulse type	The above listed variables can be connected to any output.
Configuration	By means of the front key-pad	Pulse duration	Programmable from 0.001 to 10.00 kWh/kvarh per pulse. ≥100ms < 120msec (ON), ≥120ms (OFF), according to EN62052-31
Function	The outputs can work as alarm outputs but also as pulse outputs, remote controlled outputs, or in any other combination.	Remote controlled outputs	The activation of the outputs is managed through the serial communication port See “Insulation between inputs and outputs” table
Alarms	Up alarm and down alarm linked to the virtual alarms, other details see Virtual alarms	Insulation	
Min. response time	≤200ms, filters excluded. Set-point on-time delay: “0 s”.	<b>20mA analogue outputs (M O A2)</b>	
Pulse		Number of outputs	2 (max. one module per instrument)
Signal retransmission	Total: +kWh, -kWh, +kvarh, -kvarh. Partial: +kWh, -kWh, +kvarh, -kvarh.	Accuracy (@ 25°C ±5°C, R.H. ≤60%)	±0.2%FS
Pulse type	The above listed variables can be connected to any output.	Range	0 to 20mA
Pulse duration	Programmable from 0.001 to 10.00 kWh/kvarh per pulse. ≥100ms <120msec (ON), ≥120ms (OFF), according to EN62052-31	Configuration	By means of the front key-pad
Remote controlled outputs	The activation of the outputs is managed through the serial communication port See “Insulation between inputs and outputs” table	Signal retransmission	The signal output can be connected to any instantaneous variable available in the table “List of the variables that can be connected to”.
Insulation	See “Insulation between inputs and outputs” table	Scaling factor	Programmable within the whole range of retransmission; it allows the retransmission management of all values from 0 to 20 mADC.
<b>Static outputs (M O O2)</b>		Response time	≤400 ms typical (filter excluded)
Physical outputs	Opto-Mos type 2 (max. one module per instrument)	Ripple	≤1% (according to IEC 60688-1, EN 60688-1)
Purpose	For either pulse output or alarm output	Total temperature drift	≤500 ppm/°C
Signal	V <sub>ON</sub> : 2.5VAC/DC/max.100mA V <sub>OFF</sub> : 260VAC/DC max.	Load	≤600Ω
Configuration	By means of the front key-pad	Insulation	See “Insulation between inputs and outputs” table
Function	The outputs can work as alarm outputs but also as pulse outputs, remote controlled outputs, or in any other combination.	<b>10VDC analogue outputs (M O V2)</b>	
Alarms	Up alarm and down alarm linked to the virtual alarms, other details see Virtual alarms	Number of outputs	2 (max. one module per instrument)
		Accuracy (@ 25°C ±5°C, R.H. ≤60%)	±0.2%FS
		Range	0 to 10 VDC
		Configuration	By means of the front key-pad

## Output specifications (cont.)

Signal retransmission	The signal output can be connected to any instantaneous variable available in the table "List of the variables that can be connected to".	Connections	3 wires. Max. distance 15m MODBUS RTU /JBUS
Scaling factor	Programmable within the whole range of retransmission; it allows the retransmission management of all values from 0 to 10VDC.	Protocol Data (bidirectional) Dynamic (reading only)	System and phase variables: see table "List of variables..."
Response time	≤400 ms typical (filter excluded)	Static (reading and writing only)	All the configuration parameters
Ripple	≤1% (according to IEC 60688-1, EN 60688-1)	Data format	1 start bit, 8 data bit, no/even/odd parity, 1 stop bit
Total temperature drift	≤500 ppm/°C	Baud-rate	Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s
Load	≥10kΩ	Note	With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading is allowed.
Insulation	See "Insulation between inputs and outputs" table		
<b>RS485/RS422 port (on request)</b>			
Type	Multidrop, bidirectional (static and dynamic variables)	Insulation	See "Insulation between inputs and outputs" table
Connections	2-wire Max. distance 1000m, termination directly on the module	<b>Ethernet/Internet port (on request)</b>	
Addresses	247, selectable by means of the front key-pad	Protocols IP configuration	Modbus TCP/IP Static IP / Netmask / Default gateway
Protocol	MODBUS/JBUS (RTU)	Port	Selectable (default 502)
Data (bidirectional)		Client connections	Max 5 simultaneously
Dynamic (reading only)	System and phase variables: see table "List of variables..."	Connections	RJ45 10/100 BaseTX Max. distance 100m
Static (reading and writing only)	All the configuration parameters.	Data (bidirectional) Dynamic (reading only)	System and phase variables: see table "List of variables..."
Data format	1 start bit, 8 data bit, no/even/odd parity, 1 stop bit	Static (reading and writing only)	All the configuration parameters.
Baud-rate	Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s	Note	With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading is allowed.
Driver input capability	1/5 unit load. Maximum 160 transceivers on the same bus.	Insulation	See "Insulation between inputs and outputs" table
Note	With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading is allowed.	<b>BACnet-IP (on request)</b>	
Insulation	See "Insulation between inputs and outputs" table	Protocols	BACnet-IP (for measurement reading purpose) and Modbus TCP/IP (for measurement
<b>RS232 port (on request)</b>			
Type	Bidirectional (static and dynamic variables)		



## Output specifications (cont.)

IP configuration	reading purpose and for programming parameter purpose) Static IP / Netmask / Default gateway	Static (reading and writing only)	All the configuration parameters (Modbus only). With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading is allowed. See "Insulation between inputs and outputs" table
BACnet-IP Port	Fixed: BAC0h	Note	
Modbus Port	Selectable (default 502)		
Client connections	Modbus only: max 5 simultaneously		
Connections	RJ45 10/100 BaseTX Max. distance 100m		
Data			
Dynamic (reading only)	System and phase variables (BACnet-IP and Modbus): see table "List of variables..."	Insulation	

## Energy meters

<b>Meters</b>		<b>Energy Meters</b>	
Total	4 (9+1 digit)	Total energy meters	+kWh, +kvarh, -kWh, -kvarh
Partial	4 (9+1 digit)	Partial energy meters	+kWh, +kvarh, -kWh, -kvarh
<b>Pulse output</b>	Connectable to total and/or partial meters		
<b>Energy meter recording</b>	Storage of total and partial energy meters. Energy meter storage format (EEPROM) Min. -9,999,999,999.9 kWh/kvarh Max. 9,999,999,999.9 kWh/kvarh.		

## Harmonic distortion analysis

<b>Analysis principle</b>	FFT	<b>System</b>	The harmonic distortion can be measured in 3-wire or 4-wire systems. Tw: 0.02 sec@50Hz without filter
<b>Harmonic measurement</b>			
Current	Up to the 32nd harmonic		
Voltage	Up to the 32nd harmonic		
<b>Type of harmonics</b>	THD (VL1 and VL1-N) The same for the other phases: L2, L3. THD (AL1) The same for the other phases: L2, L3.		





## Display, LED's and commands

<b>Display refresh time</b>	≤ 100 ms	<b>Energy consumption</b> kWh pulsating	Red LED (only kWh) 0.001 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≤7 0.01 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥7.1 ≤70.0 0.1 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥70.1 ≤700.0 1 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥700.1 ≤7000 10 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥7001 ≤70.00k 100 kWh/kvarh by pulse if the Ct ratio by VT ratio is >70.01k Max frequency: 16Hz, according to EN50470-1
<b>Display</b>	4 lines, 4-DGT, 1 lines, 10-DGT		
Type	LCD, single colour backlight	<b>Back position LEDs</b> On the base On the communication modules	Green as power-on Two LEDs: one for TX (green) and one for RX (amber).
Digit dimensions	4-DGT: h 9.5mm; 10-DGT: h 6.0mm		
Instantaneous variables read-out Energies variables read-out	4-DGT Imported Total/Partial: 9+1DGT or 10DGT; Exported Total/Partial: 9+1DGT or 10DGT (with “-“ sign).		
Run Hours counter	8+2 DGT (99.999.999 hours and 59 minutes max)		
Overload status	EEEE indication when the value being measured is exceeding the “Continuous inputs overload” (maximum measurement capacity)	<b>Key-pad</b>	For variable selection, programming of the instrument working parameters, “dmd”, “max”, total energy and partial energy Reset
Max. and Min. indication	Max. instantaneous variables: 9999; energies: 9 999 999 99.9 or 9 999 999 999. Min. instantaneous variables: 0.000; energies 0.0		
<b>Front position LEDs</b> Virtual alarms	4 red LED available in case of virtual alarm (AL1-AL2-AL3-AL4). Note: the real alarm is just the activation of the proper static or relay output if the proper module is available.		

## Main functions

<b>Password</b>	Numeric code of max. 4 digits; 2 protection levels of the programming data:	System 3-Ph.2 balanced load	measurements 3-phase (4-wire), one current and 3-phase to neutral voltage measurements.
1st level	Password “0”, no protection;		
2nd level	Password from 1 to 9999, all data are protected		3-phase (2-wire), one current and 1-phase (L1) to neutral voltage measurement.
<b>System selection</b>		System 2-Ph System 1-Ph	2-phase (3-wire) 1-phase (2-wire)
System 3-Ph.n unbalanced load	3-phase (4-wire)	<b>Transformer ratio</b> VT (PT)	1.0 to 999.9 / 1000 to 9999.
System 3-Ph. unbalanced load	3-phase (3-wire), three currents and 3-phase to phase voltage measurements, or in case of Aaron connection two currents (with special wiring on screw terminals) and 3-phase to phase voltage measurements.		
System 3-Ph.1 balanced load	3-phase (3-wire), one current and 3-phase to phase voltage	CT	1.0 to 999.9 / 1000 to 9999 (up to 10kA in case of CT with 1A secondary current and up to 50kA in case of CT with 5A secondary current).

## Main functions (cont.)

<b>Filter</b> Operating range Filtering coefficient Filter action	Selectable from 0 to 100% of the input display scale Selectable from 1 to 32 Measurements, analogue signal retransmission, serial communication (fundamental variables: V, A, W and their derived ones).	On-time delay Min. response time	0 to 9999s ≤ 200ms, filters excluded. Set-point on-time delay: "0 s".
<b>Displaying</b> Number of variables Backlight	Up to 5 variables per page. See "Front view". 7 different set of variables available (see "Display pages") according to the application being selected. One page is freely programmable as combination of variables. The backlight time is programmable from 0 (always on) to 255 minutes	<b>Reset</b>	By means of the front keypad. It is possible to reset the following data: - all the max and dmd values. - total energies: kWh, kvarh; - partial energies: kWh, kvarh
<b>Virtual alarms</b> Working condition No. of alarms Working mode Controlled variables Set-point adjustment Hysteresis	In case of basic unit or with the addition of M O R2 or M O O2 digital output modules. Up to 4 Up alarm and down alarm. The alarms can be connected to any instantaneous variable available in the table "List of the variables that can be connected to". From 0 to 100% of the display scale From 0 to full scale	<b>Harmonic analysis</b> <b>Clock</b> Functions Time format Date format Battery life	Up to the 32 <sup>nd</sup> harmonics on current and voltage Universal clock and calendar. Hour: minutes: seconds with selectable 24 hours or AM/PM format. Day-month-year with selectable DD-MM-YY or MM-DD-YY format. 10 years
		<b>Easy connection function</b>	For all the display selections, both energy and power measurements are independent from the current direction. The displayed energy is always "imported" with the only exception of "D", "F" and "G" types (see "display pages" table). For those latter selections the energies can be either "imported" or "exported" depending on the current direction.

## General specifications

<b>Operating temperature</b>	-25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053-23	<b>Dielectric strength</b>	4kVAC RMS for 1 minute
<b>Storage temperature</b>	-30°C to +70°C (-22°F to 158°F) (R.H. < 90% non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053-23	<b>Noise rejection CMRR</b>	100 dB, 48 to 62 Hz
<b>Installation category</b>	Cat. III (IEC60664, EN60664)	<b>EMC</b> Electrostatic discharges Immunity to irradiated Electromagnetic fields Burst Immunity to conducted disturbances Surge	According to EN62052-11 15kV air discharge Test with current: 10V/m from 80 to 2000MHz Test without any current: 30V/m from 80 to 2000MHz On current and voltage measuring inputs circuit: 4kV 10V/m from 150KHz to 80MHz On current and voltage measuring inputs circuit: 4kV; on "L" auxiliary power
<b>Insulation (for 1 minute)</b>	See "Insulation between inputs and outputs" table		



## General specifications (cont.)

Radio frequency suppression	supply input: 1kV According to CISPR 22	<b>Housing DIN</b> Dimensions (WxHxD)	Module holder: 96x96x50mm. “A” and “B” type modules: 89.5x63x16mm. “C” type module: 89.5x63x20mm. With 3 modules (A+B+C): 81.7 mm
<b>Standard compliance</b>	IEC60664, IEC61010-1 EN60664, EN61010-1 EN62052-11. EN62053-21, EN62053-23, EN50470-3.		
Safety	Metrology	Max. depth behind the panel	ABS, self-extinguishing: UL 94 V-0
Pulse output	MID "annex MI-003" DIN43864, IEC62053-31	Material	Panel mounting
<b>Approvals</b>	CE, cULus "Listed"	<b>Mounting</b>	
<b>Connections</b>	Screw-type max. 2.5 mm <sup>2</sup> . min./max. screws tightening torque: 0.4 Nm / 0.8 Nm. Suggested screws tightening torque: 0.5 Nm	<b>Protection degree</b> Front Screw terminals	IP65, NEMA4x, NEM12 IP20
Cable cross-section area		<b>Weight</b>	Approx. 400 g (packing included)

## Power supply specifications

Auxiliary power supply	H: 90 to 260VAC/DC; L: 18 to 60VAC/DC (48 to 62Hz)	Power consumption	AC: 6 VA; DC: 3.5 W
------------------------	----------------------------------------------------------	-------------------	------------------------

## Insulation between inputs and outputs

	Measuring Inputs	Relay outputs	Static Outputs	Communication port	Analogue Outputs	Auxiliary power supply
Measuring Inputs	-	4kV	4kV	4kV	4kV	4kV
Relay outputs	4kV	2kV	NA	4kV	4kV	4kV
Static Outputs	4kV	NA	2kV	4kV	4kV	4kV
Communication port	4kV	4kV	4kV	-	4kV	4kV
Analogue Outputs	4kV	4kV	4kV	4kV	0kV	4kV
Aux. power supply	4kV	4kV	4kV	4kV	4kV	-

**NOTE:** in the table “NA” means combination of modules not allowed.

**NOTE:** all the models have, mandatory, to be connected to external current transformers because the isolation among the current inputs is just functional (100VAC).

## List of the variables that can be connected to:

- Communication port (all listed variables)
- Analogue outputs (all variables with the only exclusion of “energies” and “run hour counter”)
- Pulse outputs (only “energies”)
- Alarm outputs (“energies”, “hour counter” and “max” excluded)

No	Variable	1-ph. sys	2-ph. sys	3-ph. 3/4-wire balanced sys	3-ph. 2-wire balanced sys	3-ph. 3-wire unbal. sys	3-ph. 4-wire unbal. sys	Notes
1	VL-N sys	O	X	X	X	#	X	sys= system= $\Sigma$ (1)
2	VL1	X	X	X	X	#	X	(1)
3	VL2	O	X	X	X	#	X	(1)
4	VL3	O	O	X	X	#	X	(1)
5	VL-L sys	O	X	X	X	X	X	sys= system= $\Sigma$ (1)
6	VL1-2	#	X	X	X	X	X	(1)
7	VL2-3	#	O	X	X	X	X	(1)
8	VL3-1	#	O	X	X	X	X	(1)
9	AL1	X	X	X	X	X	X	(1)
10	AL2	O	X	X	X	X	X	(1)
11	AL3	O	O	X	X	X	X	(1)
12	VA sys	X	X	X	X	#	X	sys= system= $\Sigma$ (1)
13	VA L1	X	X	X	X	#	X	(1)
14	VA L2	O	X	X	X	#	X	(1)
15	VA L3	O	O	X	X	#	X	(1)
16	var sys	X	X	X	X	#	X	sys= system= $\Sigma$ (1)
17	var L1	X	X	X	X	#	X	(1)
18	var L2	O	X	X	X	#	X	(1)
19	var L3	O	O	X	X	#	X	(1)
20	W sys	X	X	X	X	X	X	sys= system= $\Sigma$ (1)
21	WL1	X	X	X	X	#	X	(1)
22	WL2	O	X	X	X	#	X	(1)
23	WL3	O	O	X	X	#	X	(1)
24	PF sys	X	X	X	X	#	X	sys= system= $\Sigma$ (1)
25	PF L1	X	X	X	X	#	X	(1)
26	PF L2	O	X	X	X	#	X	(1)
27	PF L3	O	O	X	X	#	X	(1)
28	Hz	X	X	X	X	X	X	(1)
29	Phase seq.	O	X	X	X	X	X	
30	Asy VLL	O	O	X	X	X	X	Asymmetry
31	Asy VLN	O	O	X	X	O	X	Asymmetry
32	Run Hours	X	X	X	X	X	X	
33	kWh (+)	X	X	X	X	X	X	Total
34	kvarh (+)	X	X	X	X	#	X	Total
35	kWh (+)	X	X	X	X	X	X	Partial
36	kvarh (+)	X	X	X	X	#	X	Partial
37	kWh (-)	X	X	X	X	X	X	Total
38	kvarh (-)	X	X	X	X	#	X	Total
39	kWh (-)	X	X	X	X	X	X	Partial
40	kvarh (-)	X	X	X	X	#	X	Partial
41	A L1 THD	X	X	X	X	X	X	(1)
42	A L2 THD	O	X	X	X	X	X	(1)
43	A L3 THD	O	O	X	X	X	X	(1)
44	V L1 THD	X	X	X	X	O	X	(1)
45	V L2 THD	O	X	X	X	O	X	(1)
46	V L3 THD	O	O	X	X	O	X	(1)
47	V L1-2 THD	X	X	X	X	X	X	(1)
48	V L2-3 THD	O	X	X	X	X	X	(1)
49	V L3-1 THD	O	O	X	X	X	X	(1)

(X) = available; (O) = not available (variable not available on the display); (#) Not available (the relevant page is not displayed) (1) Max. value with data storage

## List of selectable applications

	Description	Notes
<b>A</b>	Cost allocation	Imported energy metering
<b>B</b>	Cost control	Imported and partial energy metering
<b>C</b>	Complex cost allocation	Imported/exported energy (total and partial)
<b>D</b>	Solar	Imported and exported energy metering with some basic power analyzer function
<b>E</b>	Complex cost and power analysis	Imported/exported energy (total and partial) and power analysis
<b>F</b>	Cost and power quality analysis	Imported energy and power quality analysis
<b>G</b>	Advanced energy and power analysis for power generation	Complete energy metering and power quality analysis

## Display pages

Var Type	No	Line 1 Variable Type	Line 2 Variable Type	Line 3 Variable Type	Line 4 Variable Type	Line 5 Variable Type	Note	Applications						
								A	B	C	D	E	F	G
	0	Total kW (+)	Programmable					x	x	x	x	x	x	x
a	1	Total kW (+)	b, c, d	b, c, d	b, c, d	b, c, d		x	x	x	x	x	x	
a	2	Total kvarh (+)	b, c, d	b, c, d	b, c, d	b, c, d		x	x	x	x	x	x	
a	3	Total kWh (-)	b, c, d	b, c, d	b, c, d	b, c, d				x	x	x	x	
a	4	Total kvarh (-)	b, c, d	b, c, d	b, c, d	b, c, d				x	x	x	x	
a	5	kWh (+) partial	b, c, d	b, c, d	b, c, d	b, c, d			x	x		x	x	
a	6	kvarh (+) part.	b, c, d	b, c, d	b, c, d	b, c, d			x	x		x	x	
a	7	kWh (-) partial	b, c, d	b, c, d	b, c, d	b, c, d				x		x	x	
a	8	kvarh (-) part.	b, c, d	b, c, d	b, c, d	b, c, d				x		x	x	
a	9	Run Hours (99999999.99)	b, c, d	b, c, d	b, c, d	b, c, d				x	x	x	x	
b	10	a/Phase seq.	VLN $\Sigma$	VL1	VL2	VL3	(1) (2)				x	x	x	
b	11	a/Phase seq.	VLN $\Sigma$	VL1-2	VL2-3	VL3-1	(1) (2)				x	x	x	
b	12	a/Phase seq.	An	AL1	AL2	AL3	(1) (2)				x	x	x	
b	13	a/Phase seq.	Hz	"ASY"	VLL sys (% asy)	VLL sys (% asy)	(1) (2)				x	x	x	
c	14	a/Phase seq.	W $\Sigma$	WL1	WL2	WL3	(1) (2)				x	x	x	
c	15	a/Phase seq.	var $\Sigma$	var L1	var L2	var L3	(1) (2)					x	x	
c	16	a/Phase seq.	PF $\Sigma$	PF L1	PF L2	PF L3	(1) (2)					x	x	
c	17	a/Phase seq.	VA $\Sigma$	VA L1	VA L2	VA L3	(1) (2)					x	x	
d	18	a/Phase seq.		THD V1	THD V2	THD V3	(1) (2)						x	
d	19	a/Phase seq.		THD V12	THD V23	THD V31	(1) (2)						x	
d	20	a/Phase seq.		THD A1	THD A2	THD A3	(1) (2)						x	


(1) Also maximum value storage.

(2) Also average (dmd) value storage.

## Additional available information on the display


No	Line 1	Line 2	Line 3	Line 4	Line 5	Note	Applications						
							A	B	C	D	E	F	G
1	Lot n. (text) xxxx	Yr. (text) xx	SYS (text)	x (1/2/3)	1...60 (min) "dmd"		x	x	x	x	x	x	x
2	Conn. xxx.x (3ph.n/3ph/3ph./ 3ph.2/1ph/2ph)	CT.rA (text)	1.0 ... 99.99k	PT.rA (text)	1.0...9999		x	x	x	x	x	x	x
3	LED PULSE (text) kWh	xxxx kWh per pulse					x	x	x	x	x	x	x
4	PULSE out1 (text) kWh/kvarh	xxxx kWh/kvarh per pulse	+/- tot/PAr				x	x	x	x	x	x	x
5	PULSE out2 (text) kWh/kvarh	xxxx kWh/kvarh per pulse	+/- tot/PAr				x	x	x	x	x	x	x
6	Remote out	out1 (text)	on/oFF	Out2 (text)	on/oFF		x	x	x	x	x	x	x
7	Alarm 1 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					x	x	x	x
8	Alarm 2 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					x	x	x	x
9	Alarm 3 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					x	x	x	x
10	Alarm 4 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					x	x	x	x
11	Analogue 1	Hi:E	0.0 ... 9999	Hi.A	0.0 ... 100.0%					x	x	x	x
12	Analogue 2	Hi:E	0.0 ... 9999	Hi.A	0.0 ... 100.0%					x	x	x	x
13	COM port	None / out 1 / out 2	xxx (address)	bdr (text)	9.6/19.2/ 38.4/115.2		x	x	x	x	x	x	x
14	IP address	XXX	XXX	XXX	XXX		x	x	x	x	x	x	x

## Back protection rotary switch


	Function	Rotary switch position	Description
	Unlok	1	All programming parameters are freely modifiable by means of the front key-pad and by means of the communication port.
	Lock	7	The key-pad, as far as programming is concerned and the data through the serial communication cannot be changed (no writing into meter allowed). Data reading is allowed.

## Accuracy (According to EN50470-3 and EN62053-23)

**kWh, accuracy (RDG) depending on the current**

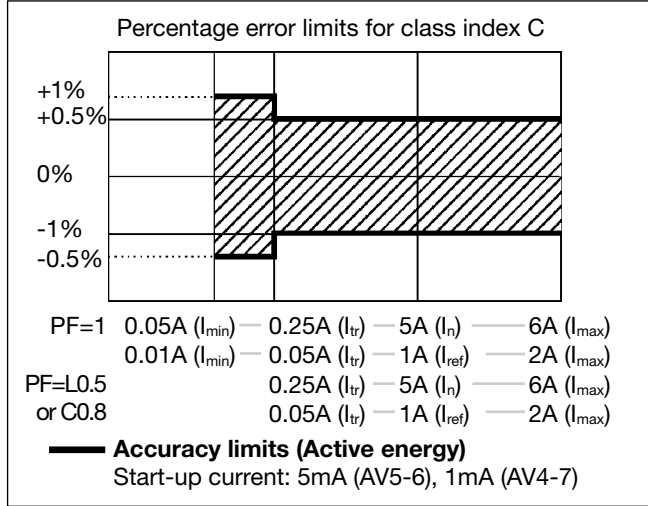

**kvarh, accuracy (RDG) depending on the current**

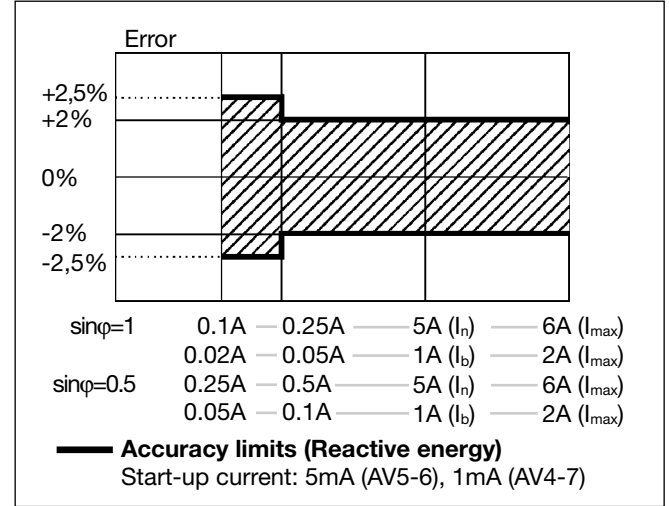

## Used calculation formulas

### Phase variables

Instantaneous effective voltage

$$V_{1N} = \sqrt{\frac{1}{n} \cdot \sum_1^n (V_{1N})_i^2}$$

Instantaneous active power

$$W_1 = \frac{1}{n} \cdot \sum_1^n (V_{1N})_i \cdot (A_1)_i$$

Instantaneous power factor

$$\cos\varphi_1 = \frac{W_1}{VA_1}$$

Instantaneous effective current

$$A_1 = \sqrt{\frac{1}{n} \cdot \sum_1^n (A_1)_i^2}$$

Instantaneous apparent power

$$VA_1 = V_{1N} \cdot A_1$$

Instantaneous reactive power

$$\text{var}_1 = \sqrt{(VA_1)^2 - (W_1)^2}$$

### System variables

Equivalent three-phase voltage

$$V_\Sigma = \frac{V_1 + V_2 + V_3}{3} \cdot \sqrt{3}$$

Voltage asymmetry

$$ASY_{LL} = \frac{(V_{LL\max} - V_{LL\min})}{V_{LL\Sigma}}$$

$$ASY_{LN} = \frac{(V_{LN\max} - V_{LN\min})}{V_{LN\Sigma}}$$

Three-phase reactive power

$$\text{var}_\Sigma = (\text{var}_1 + \text{var}_2 + \text{var}_3)$$

Three-phase active power

$$W_\Sigma = W_1 + W_2 + W_3$$

Three-phase apparent power

$$VA_\Sigma = \sqrt{W_\Sigma^2 + \text{var}_\Sigma^2}$$

Total harmonic distortion

$$THD_N = 100 \frac{\sqrt{\sum_{n=2}^N |X_n|^2}}{|X_1|}$$

Three-phase power factor

$$\cos\varphi_\Sigma = \frac{W_\Sigma}{VA_\Sigma} \quad (\text{TPF})$$

### Energy metering

$$k \text{ var hi} = \int_{t_1}^{t_2} Qi(t) dt \cong \Delta t \sum_{n_1}^{n_2} Qnj$$




$$kWhi = \int_{t_1}^{t_2} Pi(t) dt \cong \Delta t \sum_{n_1}^{n_2} Pnj$$

Where:



i= considered phase (L1, L2 or L3)  
P= active power; Q= reactive power;  
t<sub>1</sub>, t<sub>2</sub>=starting and ending time points of consumption recording; n= time unit; Δt= time interval between two successive power consumptions;  
n<sub>1</sub>, n<sub>2</sub>= starting and ending discrete time points of consumption recording

# Wiring diagrams


## System type selection: 3-Ph.2

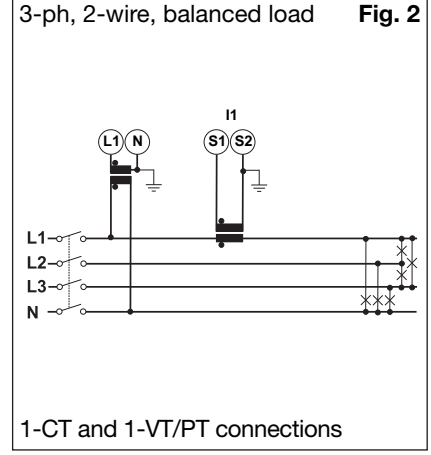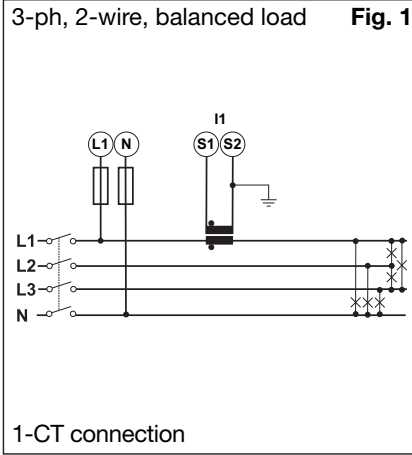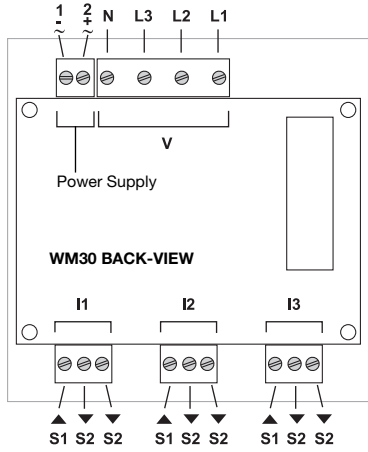




## System type selection: 3-Ph.n

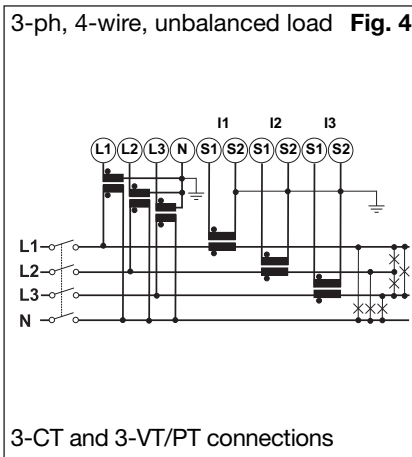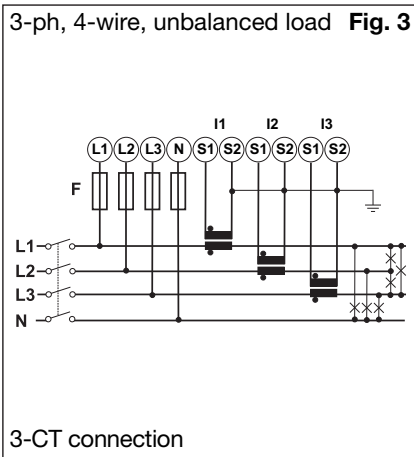

## System type selection: 3-Ph

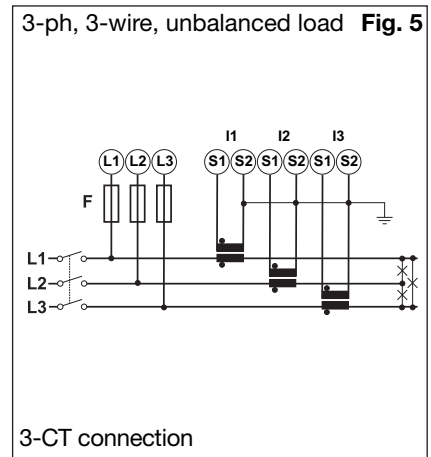




## System type selection: 3-Ph (cont.)

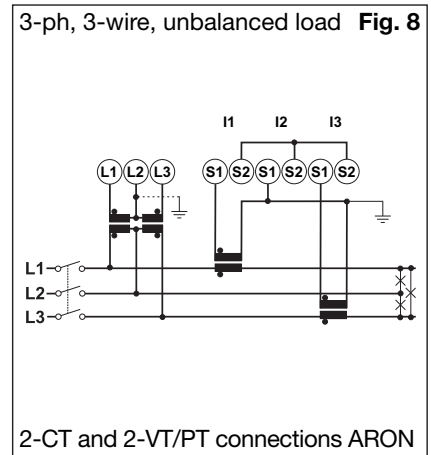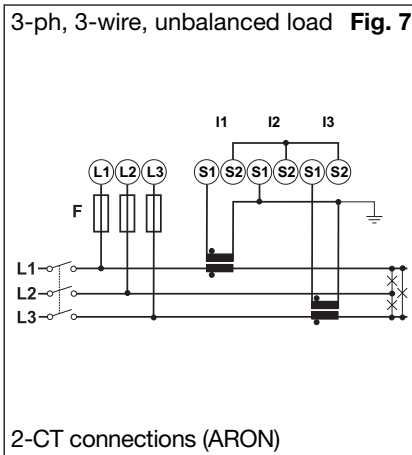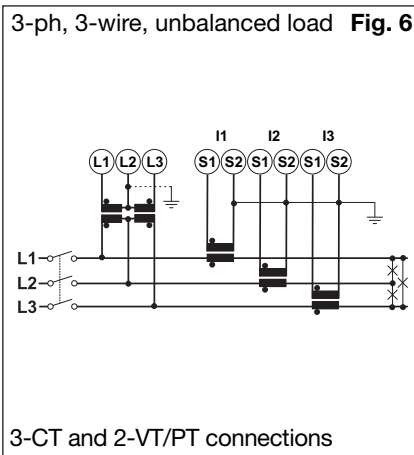





# Wiring diagrams


## System type selection: 3-Ph.1

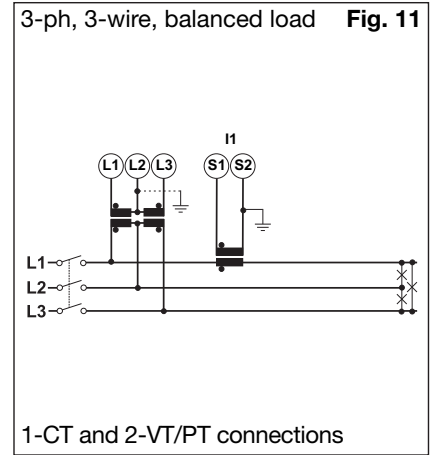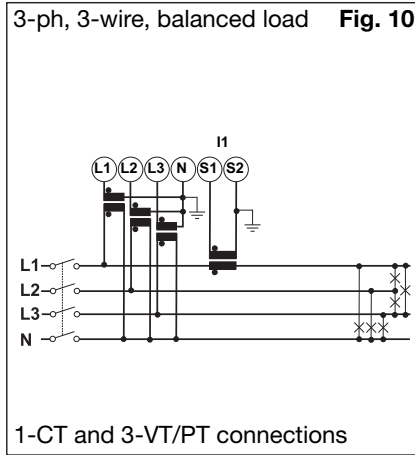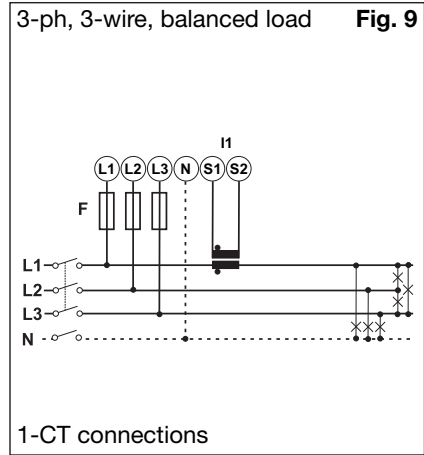


## System type selection: 2-Ph

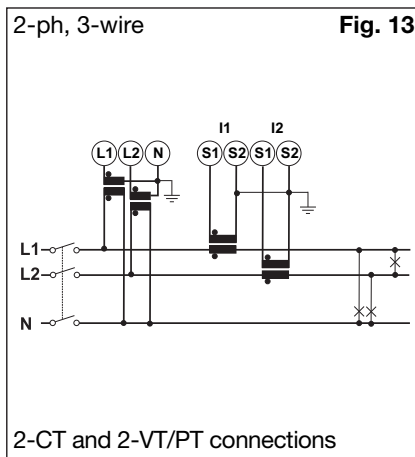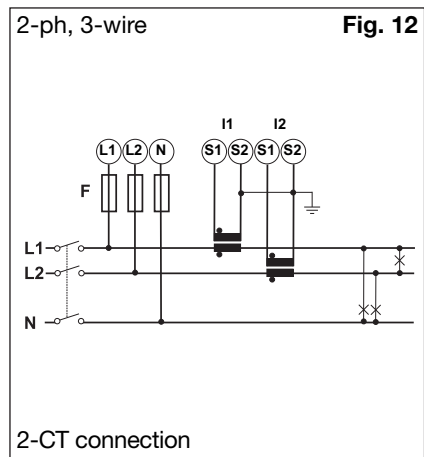



## System type selection: 1-Ph

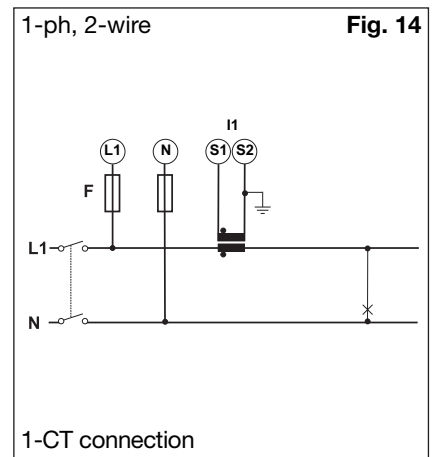







## System type selection: 1-Ph (cont.)

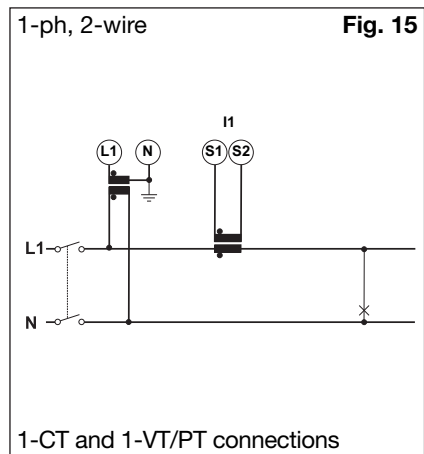




## Power Supply

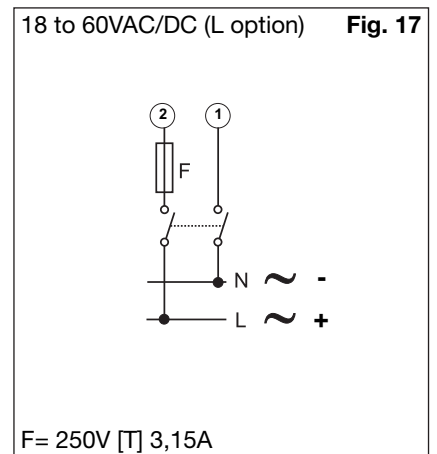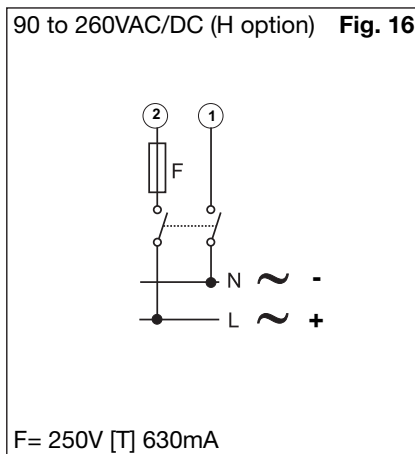

## Static, relay and analogue outputs wiring diagrams

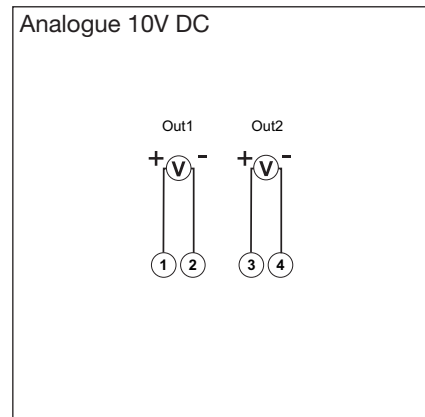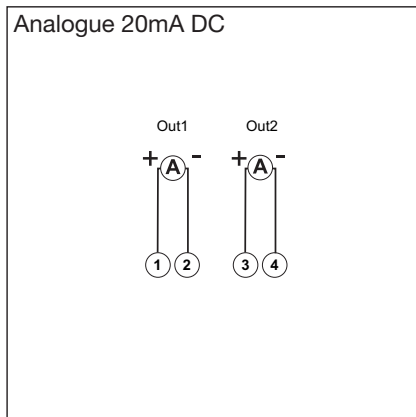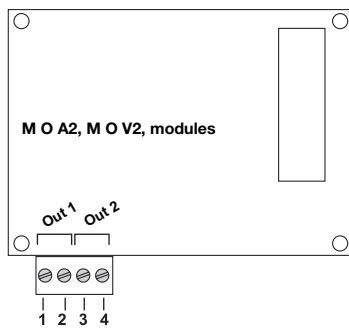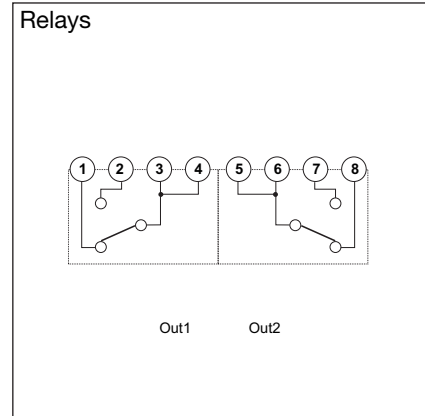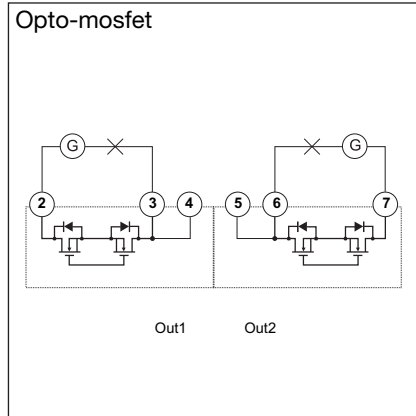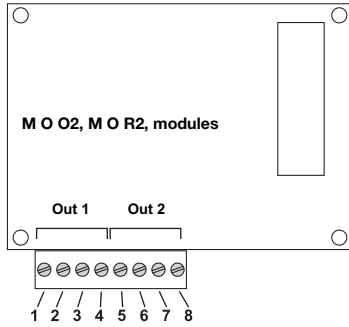


## RS485 and RS232 wiring diagrams

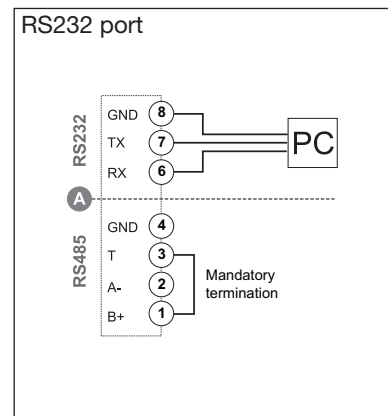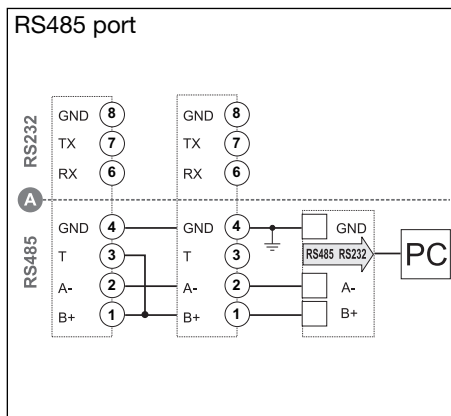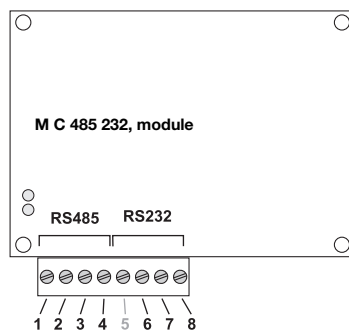

**NOTE.** RS485: additional devices provided with RS485 are connected in parallel. The termination of the serial output is carried out only on the last instrument of the network, by means of a jumper between (B+) and (T). **A**: the communication RS232 and RS485 ports **can't be** connected and used simultaneously.

## Front panel description

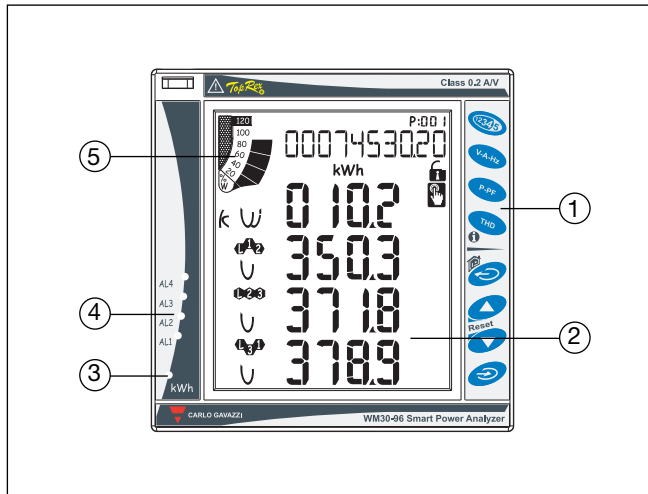

1. **Key-pad**  
To program the configuration parameters and scroll the variables on the display.
2. **Display**  
LCD-type with alphanumeric indications to:
  - display configuration parameters;
  - display all the measured variables.
3. **kWh LED**  
Red LED blinking proportional to the energy being measured
4. **Alarm LED's**  
Red LED's light-on when virtual alarms are activated.
5. **Main bar-graph**  
To display the power consumption versus the installed power.

## Dimensions and Panel cut-out

